


## INVERTER - INTERRUPTIBLE

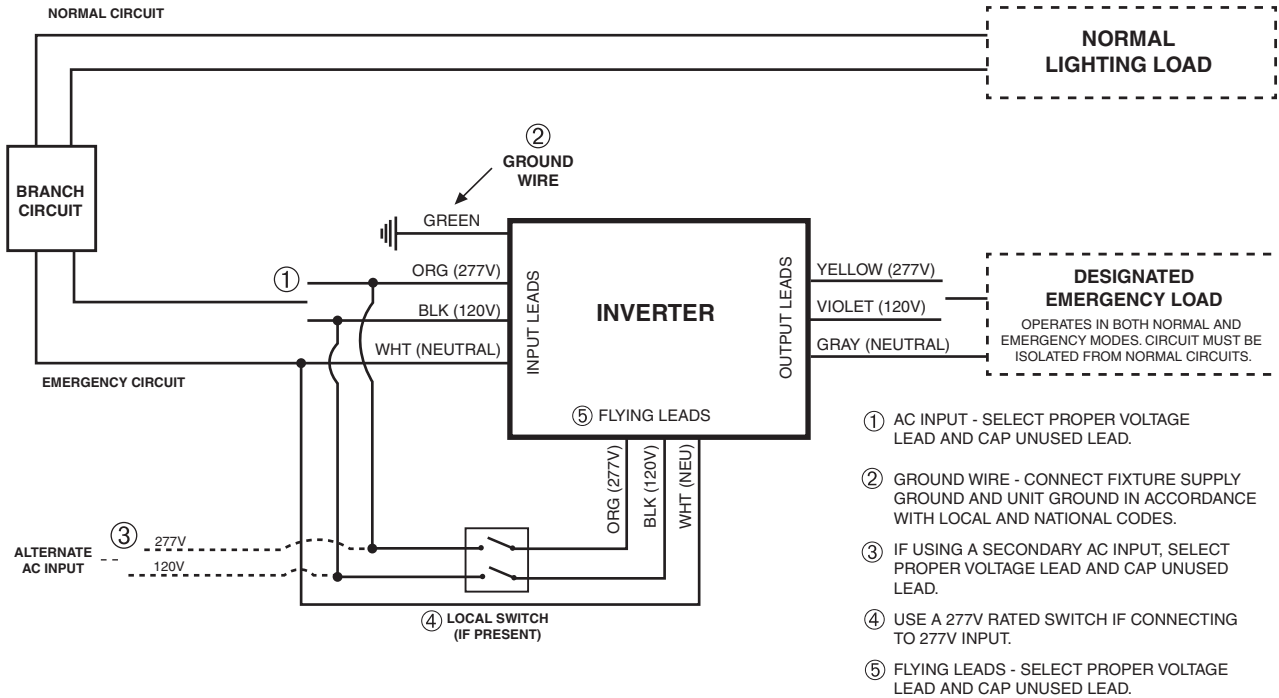

IIS\_125\_375\_550\_UPDATE.EPS

### NOTES